


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

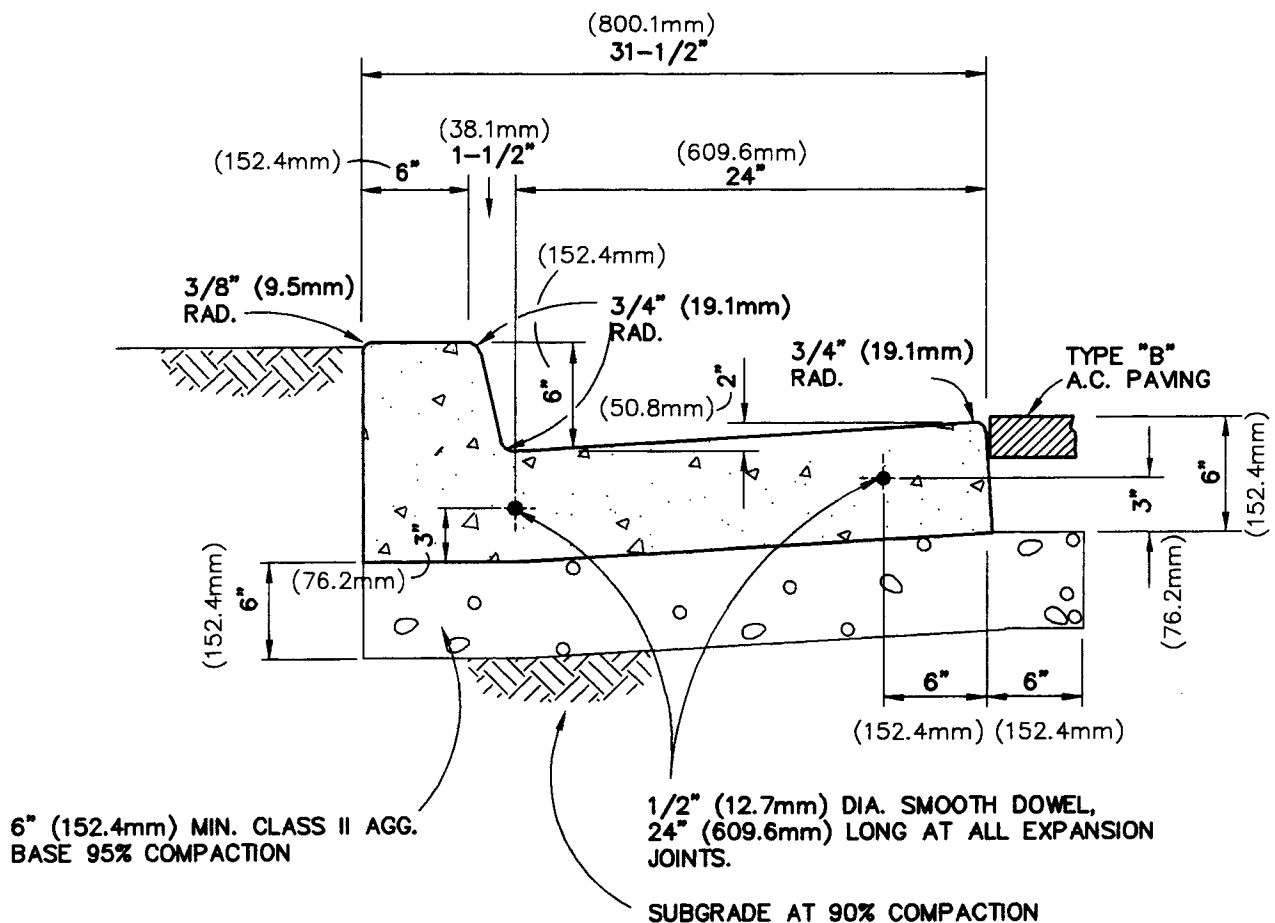

NOTES:

1. CONCRETE SHALL BE 5 SACK CRUSHED AGGREGATE 3/4" AT 2500 PSI.
2. EXPANSION JOINTS SHALL BE PLACED AT 40' (12.2m) INTERVALS FOR EXTRUSIONS AND AT 20' (6.1m) INTERVALS WITH FORMS. DEEP JOINTS SHALL BE AT 10' (3.0m) INTERVALS.

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	6" (152.4mm) CURB AND GUTTER	B-1
FILE NAME: PR-B-1.DWG		